




## Airmix RH measurement climate computer

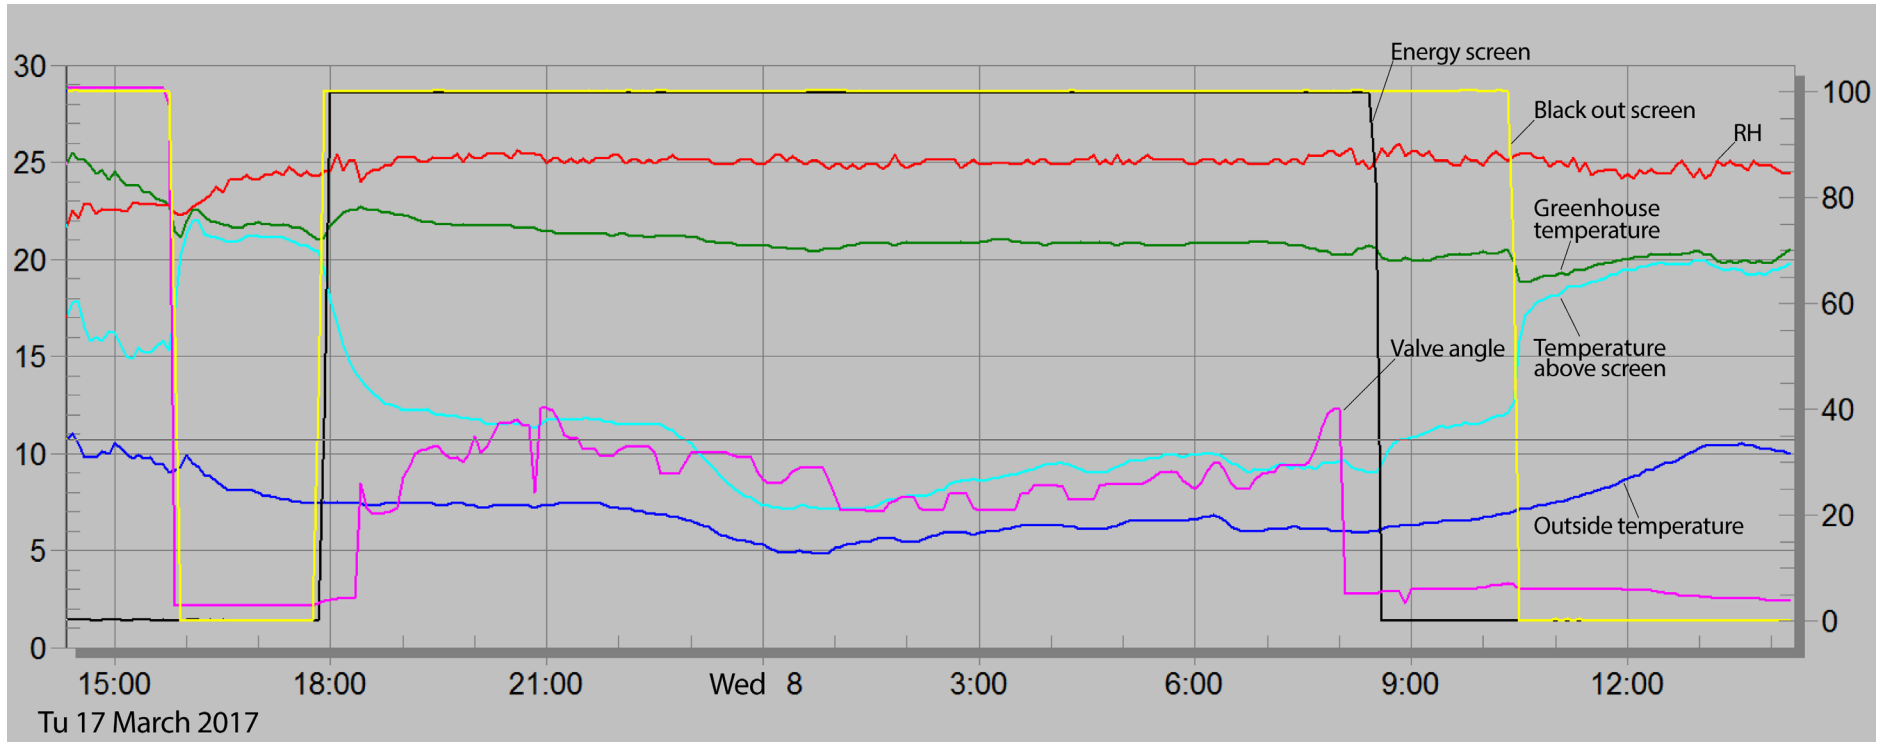

|  | Items  | Unit | Group                    | Factor | Ash | Min  | Max   | Average | Line  |
|--|--|------|--------------------------|--------|-----|------|-------|---------|-------|
| <span style="color: red;">█</span>     | <input checked="" type="checkbox"/> RH                                   | %    | Dept. 5                  | 1      | ->  | 75   | 90    | 86      | 75    |
| <span style="color: blue;">█</span>    | <input checked="" type="checkbox"/> Outside temperature                  | *C   | Weather                  | 1      | <-  | 4.8  | 11.0  | 7.2     | 10.7  |
| <span style="color: green;">█</span>   | <input checked="" type="checkbox"/> Greenhouse temperature               | *C   | Dept. 5                  | 1      | <-  | 18.8 | 25.5  | 21.0    | 24.9  |
| <span style="color: cyan;">█</span>    | <input checked="" type="checkbox"/> Greenhouse temperature, above screen | *C   | Above screen dept. 5     | 1      | <-  | 7.1  | 22.0  | 12.8    | 17.0  |
| <span style="color: black;">█</span>   | <input checked="" type="checkbox"/> Energy screen                        | %    | Dept. 5 Engery screen    | 1      | ->  | 0    | 100   | 61      | 0     |
| <span style="color: magenta;">█</span> | <input checked="" type="checkbox"/> Valve angle                          | %    | Dept. 5+6                | 1      | ->  | 2.8  | 100.6 | 23.9    | 100.6 |
| <span style="color: yellow;">█</span>  | <input checked="" type="checkbox"/> Black out screen                     | %    | Dept. 5 black out screen | 1      | ->  | 0    | 100   | 76      | 100   |